


MINNESOTA RULES, CHAPTER 4714, SECTIONS 407.3, 408.3 409.4, 410.3, AND 416.2

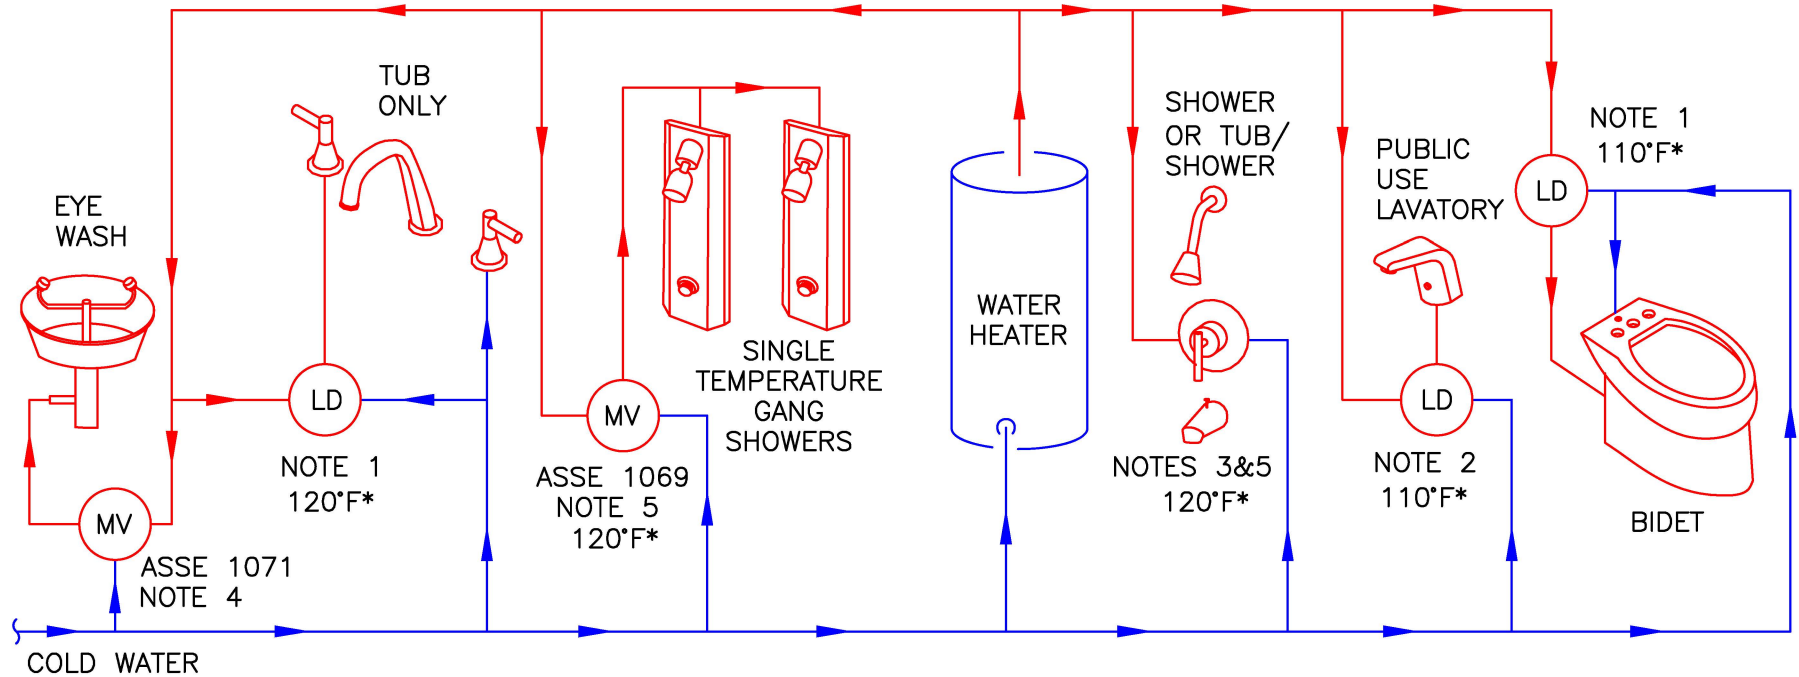

LD = LIMITING DEVICE

MV = MIXING VALVE

* = MAXIMUM TEMPERATURE ALLOWED BY CODE

NOTE 1: MAXIMUM TEMPERATURE REGULATED BY: (1) A LIMITING DEVICE CONFORMING TO ASSE 1070/ASME A112.1070/CSA B125.70 OR CSA B125.3, OR (2) A WATER HEATER CONFORMING TO ASSE 1084.

NOTE 2: MAXIMUM TEMPERATURE REGULATED BY: (1) A LIMITING DEVICE CONFORMING TO ASSE 1070/ASME A112.1070/CSA B125.70 OR (2) A WATER HEATER CONFORMING TO ASSE 1084.

NOTE 3: MAXIMUM TEMPERATURE REGULATED BY POINT OF USE CONTROL VALVE COMPLYING WITH ASSE 1016/ASME A112.1016/CSA B125.16 OR ASME A112.18.1/CSA B125.1. THE CONTROL VALVE MUST PROVIDE SCALD AND THERMAL SHOCK PROTECTION FOR THE RATED FLOW RATE OF THE INSTALLED SHOWERHEAD.

NOTE 4: WHEN WATER IS SUPPLIED DIRECTLY TO EMERGENCY FIXTURES FROM A WATER HEATER, THE WATER HEATER MUST COMPLY WITH ASSE 1085.

NOTE 5: WATER HEATER THERMOSTATS ARE NOT CONSIDERED A SUITABLE CONTROL.

NOTE: USING AN ASSE 1017 MASTER MIXING VALVE DOES NOT ELIMINATE THE NEED TO INSTALL THE LIMITING DEVICES AND MIXING VALVES SHOWN ABOVE